




P/N 52279-04  
**MODEL ICON15**



Balboa Instruments  
 Incorporated  
 BALBOA INSTRUMENTS INC.  
 TUSTIN, CA.



LISTED US  
 74254



60 HZ

Certified to comply with  
 the limits for a class B  
 computing device pursuant  
 to subpart J of part 15  
 of the FCC rules

**MODEL: WH-ICON15-CCAJ**  
 PAT. NO. 4618797


USE COPPER  
 CONDUCTOR  
 ONLY  
 #8 AWG MIN.  
 WIRE = 90°C  
 EMPLOYER  
 UNIFORMITY  
 DES  
 CONDUCTORS  
 DE CUIVRE.  
 TORQUE RANGE  
 FOR TB1:  
 16-18 IN. LBS

FOR SUPPLY CONNECTIONS, USE CONDUCTORS  
 SIZED ON THE BASIS OF 60°C AMPACITY BUT  
 RATED MINIMUM OF 90°C.



Balboa Instruments  
 Incorporated  
 01/20/06

**ICON15 SYSTEM WIRING DIAGRAM**

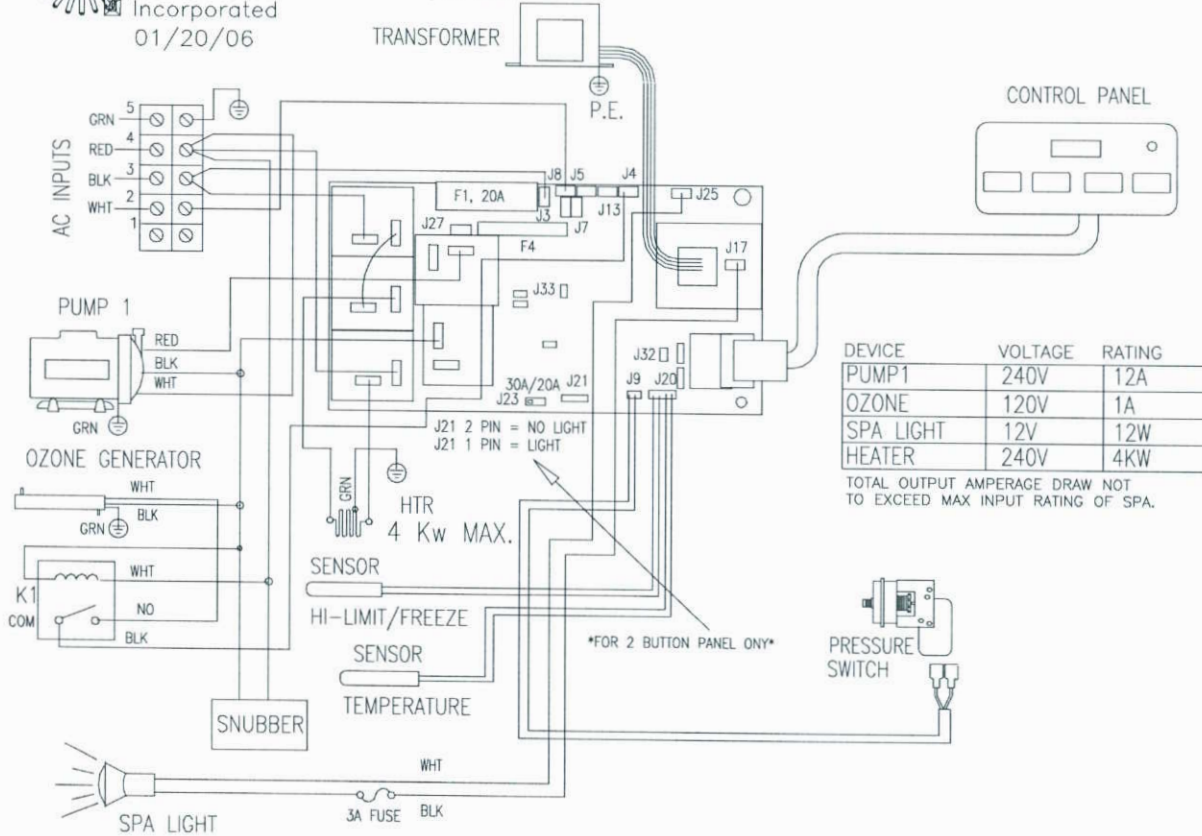

"A disconnecting means must be installed within sight from the equipment and at least 5 feet (1.52 m) from the inside walls of the pool, spa, or hot tub."